ELECTRICAL NOTES:

A. EXISTING ELECTRICAL SERVICE TO REMAIN, PROVIDE NEW ENERGY MANAGEMENT SYSTEM PANEL PER DETAILS
B. ALL SERVICE AND WIRING TO BE IN COMPLIANCE WITH THE APPLICABLE CODES
C. ELECTRICAL PANELS TO BE CORRECTLY LABELED
D. WIRING AND CIRCUITS FOR BUILDING SIGNAGE ARE SIZED PER CODE AND MEET DOLLAR GENERAL SIGN SPECIFICATIONS
E. PROVIDE AND INSTALL POWER POLE FOR REGISTERS PER DRAWING
F. PROVIDE AND INSTALL OUTLETS FOR REFRIGERATION UNITS PLACED PER PLAN 11'-0"
G. PROVIDE AND INSTALL 90 CORD DROPS FOR END CAP COOLER UNITS
H. PROVIDE AND INSTALL RECEPTACLE FOR OFFICE/BREAK ROOM AREA
I. NOT USED.
J. NOT USED.
K. EMERGENCY LIGHTING AND EXIT LIGHTING TO BE IN COMPLIANCE WITH APPLICABLE CODES
L. PROVIDE DOOR BUZZER AT RECEIVING DOOR
M. 13. PROVIDE ELECTRICAL CONNECTION FOR ELECTRICAL WATER HEATER
N. PROVIDE ELECTRICAL CONNECTION FOR NEW TOILET ROOM EXHAUST FANS. EXHAUST FANS AND LIGHT FIXTURES IN TOILET ROOMS TO INTERLOCK WITH MOTION ACTIVATED SWITCH AT TOILET ROOMS.
O. EXISTING OVERHANG LIGHT FIXTURES TO REMAIN
P. EXISTING PARKING LOT AND WALL PACK LIGHTING TO REMAIN
Q. 17. PROVIDE & INSTALL 250' OF SPEAKER WIRE IN SALES AREA, FINAL TERMINATION LOCATIONS T.B.D.

ELECTRICAL PLAN NOTES:

1. NOT USED.
2. ALL SERVICE AND WIRING TO BE IN COMPLIANCE WITH THE APPLICABLE CODES
3. ELECTRICAL PANELS / CIRCUITS TO BE CORRECTLY LABELED
4. WIRING AND CIRCUITS FOR BUILDING SIGNAGE ARE SIZED PER CODE AND MEET DOLLAR GENERAL SIGN SPECIFICATIONS
5. PROVIDE AND INSTALL POWER POLE FOR REGISTERS PER DRAWING
6. PROVIDE AND INSTALL ELECTRICAL CONNECTION FOR REFRIGERATION UNITS PLACED PER PLAN 90° AFF.
7. PROVIDE AND INSTALL 90 CORD DROPS FOR END CAP COOLER UNITS
8. PROVIDE AND INSTALL RECEPTACLES FOR OFFICE /BREAK ROOM AREA
9. PROVIDE ALL NEW LIGHTING UNLESS NOTED OTHERWISE.
10. NIGHT LIGHTS IN THE SALES AREA AS INDICATED ON ELECTRICAL DRAWINGS
11. EMERGENCY LIGHTING AND EXIT LIGHTING TO BE IN COMPLIANCE WITH APPLICABLE CODES
12. PROVIDE DOOR BUZZER AT RECEIVING DOOR
13. PROVIDE ELECTRICAL CONNECTION FOR ELECTRICAL WATER HEATER
14. PROVIDE ELECTRICAL CONNECTION OF RESTROOM EXHAUST FANS
15. PROVIDE ELECTRICAL CONNECTION FOR HVAC EQUIPMENT, PROVIDE OUTDOOR GFCI RECEPTACLE, PROVIDE DISCONNECT SWITCH FOR EQUIPMENT.
16. NOT USED
17. EXISTING PARKING LOT LIGHTING TO REMAIN
18. PROVIDE & INSTALL 250' OF SPEAKER WIRE IN SALES AREA, FINAL TERMINATION LOCATIONS T.B.D.

LIGHTING SCHEDULE

SYMB	TYPE	MANF.	PART #	DESCRIPTION	
	A	USLED	PJF1-1-4-1-50-ID-50-1	4' LED STRIP. (1) 5FT. VERTICAL POWER CABLES WITH SURFACE MOUNTING CLIPS	
	A1	USLED	PJF1-1-4-1-50-ID-50-1	4' LED STRIP. (1) 5FT. VERTICAL POWER CABLES AND (1) 10FT. HANGER CABLE (PART #30202)	
	B	USLED	PJF2-1-2-UNVL-15-50-Y	24" LED LINEAR STRIP FIXTURE, LOW PROFILE, SURFACE MOUNTED, WHITE	
	C	COST LESS LIGHTING	04-CRW2-LED	LED EXIT SIGN	
	D	COST LESS LIGHTING	JLECB2RWRC	DUAL HEAD EXIT COMBO EM LIGHT	
	E	COST LESS LIGHTING	04-EL1-LED	EMERGENCY LIGHT W/ 2 HEADS	
	G	USLED	WPR2-30-50-BR	QUBEFLOOD4	
			PRSWMBZ	WALL MOUNT PLATE	
	H	USLED	QDXLE1-120-50-UNVL-1-5-N	DoradoXLE	
			RAB42-BDB	42" HORIZONTAL x 8" VERTICAL RIGHT ANGLE BRACKET	
	S	USLED	QDXLE1-120-50-UNVL-1-5-N	DORADO XLE AREA/SITE LUMINAIRE	
			150-50-UNVL-1-5-N-Z5	24' LIGHTING POLE	
HOOKER HANGER TO BE USED TO MOUNT LIGHT FIXTURES TO CEILING GRID. HUBBELL - CGZT LITHONIA LIGHTING - HRC1J48.		ROD LEEK	DGUSLED@USLED.COM	AL, DE, FL, GA, IA, IL, IN, KS, KY, MD, MI, MN, MO, MS, NC, ND, NE, OH, SC, SD, TN, VA,WI, WV	

LIGHTING SPECIFICATIONS:

1. RECEIVING AREA LIGHTS, IF NOT INDICATED ON SHEET 'E101', TO BE SPACED EVENLY FROM FRONT AND REAR WALL OF RECEIVING AREA.
2. NIGHT LIGHTING: ADDITIONAL LIGHT FIXTURES MAY BE REQUIRED TO PROVIDE MINIMAL LIGHTING FROM ENTRY TO ELECTRICAL BREAKER PANEL. NIGHT LIGHTING TO HAVE ITS OWN DEDICATED CIRCUIT.
3. EMERGENCY / EXIT SIGNS AND LIGHTS: INSTALL EMERGENCY LIGHTS AND SIGNS THROUGHOUT THE BUILDING IN COMPLIANCE WITH ALL APPLICABLE CODES IF NOT EXISTING.

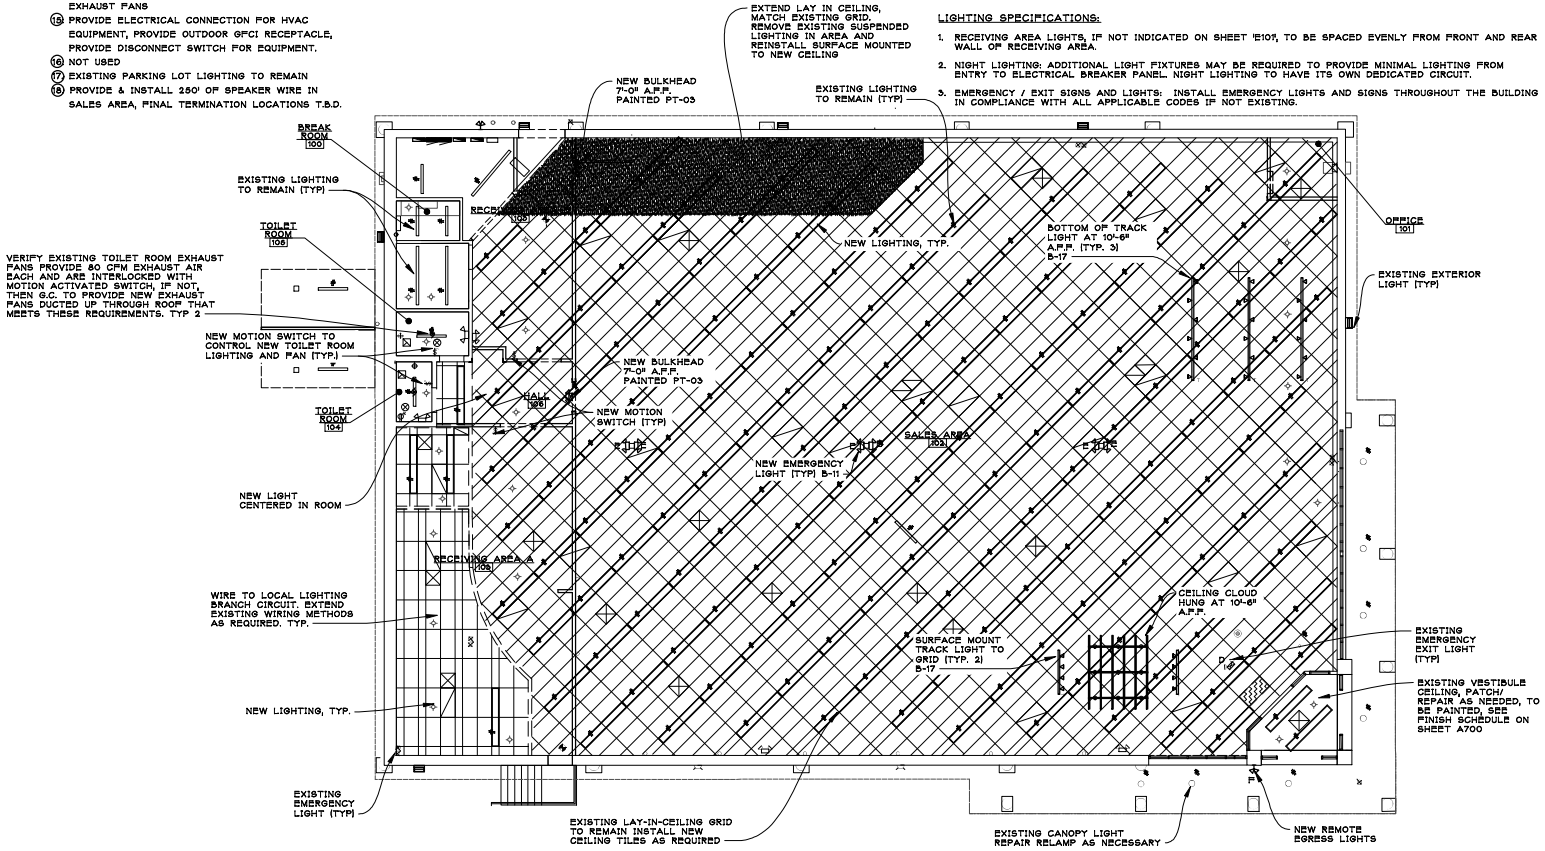

LIGHTING PLAN
SCALE: 1/8" = 1'-0"

NOTE: CONDUIT IS SHOWN SCHEMATICALLY FOR REFERENCE, ROUTE AS REQUIRED THROUGHOUT THE NEW TENANT SPACE.

WIRE EXTERIOR SIGNAGE TO A-17. FIELD VERIFY LOCATION.

ARCHITECT:
jeffery a. scott architects p.c.
32316 grand river ave.
suite 200
farmington, mi 48336
248-476-6800
JSCOTTARCHITECT@COM

copyright © 2025

SHEET TITLE: LIGHTING PLAN

PROJECT:
DOLLAR GENERAL
114 NORTH MAIN ST,
NORTH SYRACUSE, NY 13212

ISSUED FOR:
OWNER REVIEW 06/20/2025
BIDS & PERMITS 08/11/2025

REGISTERED ARCHITECT JEFFERY A. SCOTT

DO NOT SCALE PRINTS
USE FIGURED DIMENSIONS ONLY

JOB NO. 25075

SHEET NO. E101

PLOT SIZE: 36"X24"